


APPROVED

By Oregon DEQ on December 09, 2011

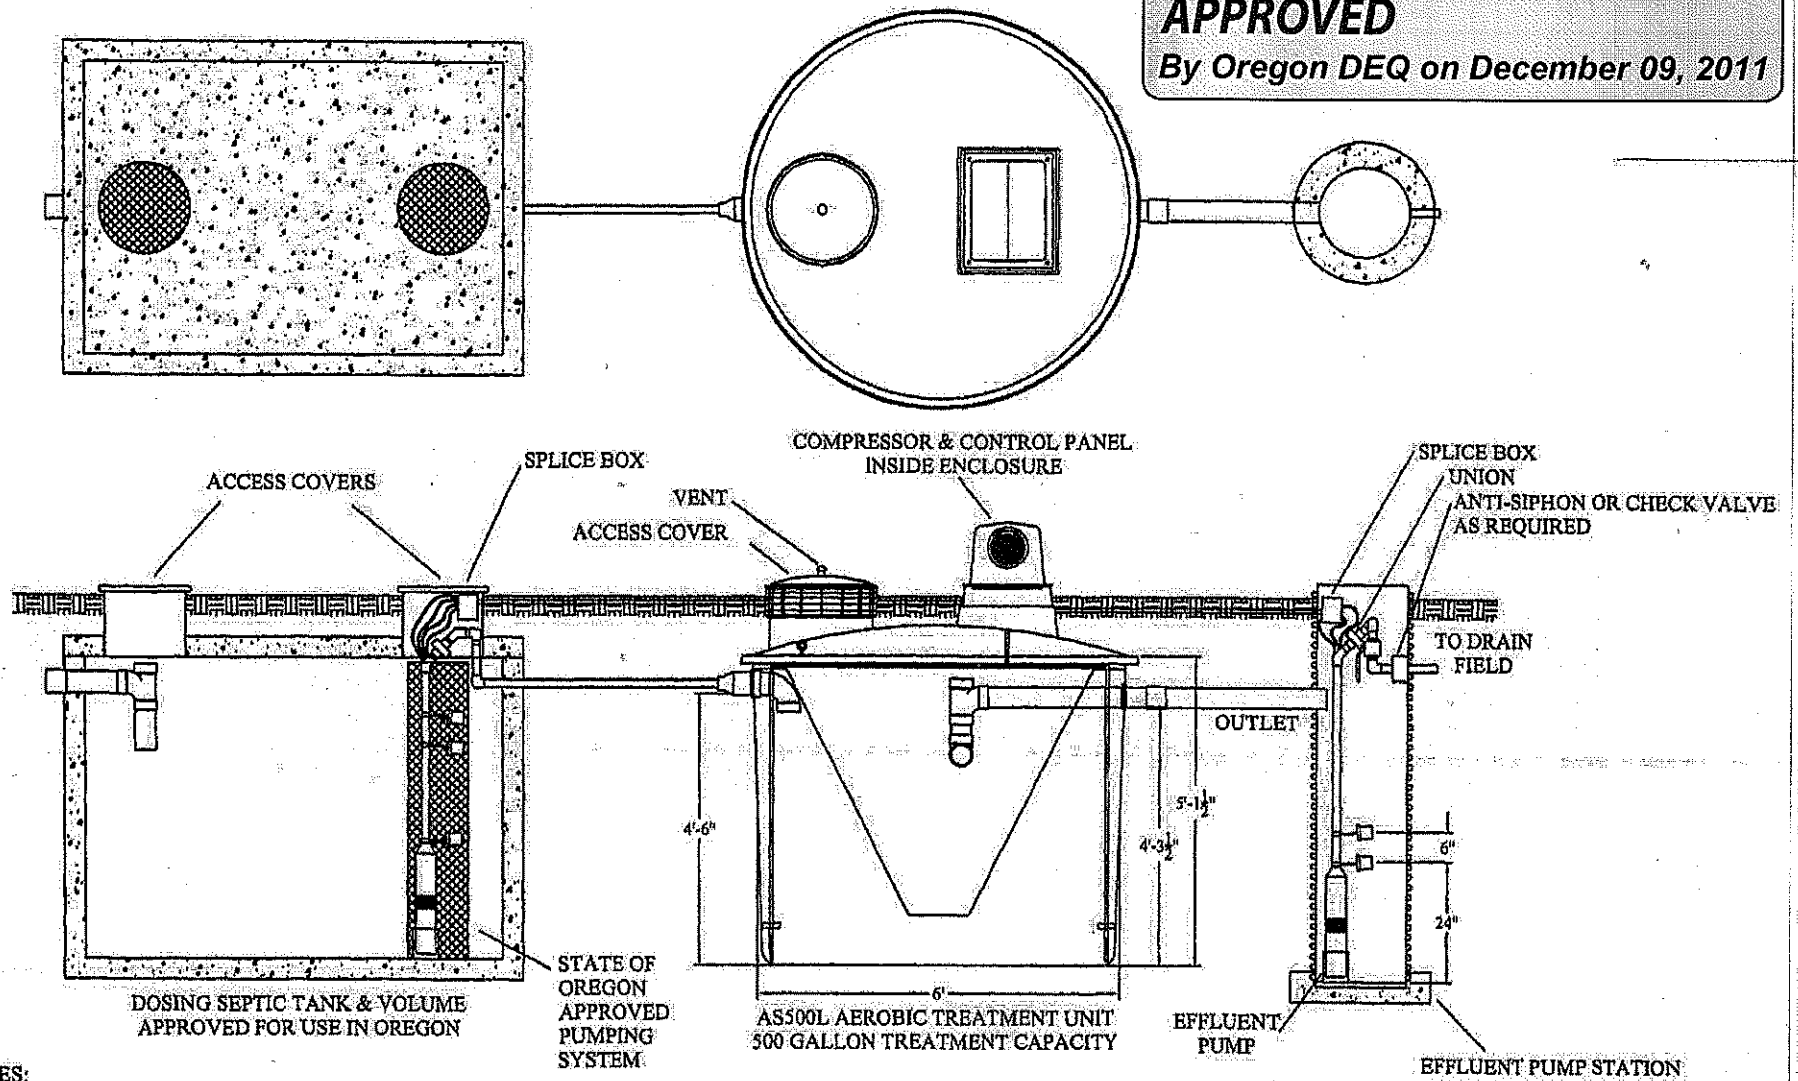

NOTES:

1. ALL EXTERIOR PIPE SIZES AS PER OREGON REQUIREMENTS.
2. THE VOLUME OF THE SEPTIC TANK WILL BE AS REQUIRED IN OAR 340-071.
3. AS AN OPTION, THE COMPRESSOR, CONTROL PANEL, AND ENCLOSURE CAN BE MOUNTED REMOTELY PROVIDED THEY ARE WITHIN 100' OF THE TREATMENT UNIT.

ECOLOGICAL TANKS, INC
2477 HWY 151 NORTH
DOWNSVILLE, LA 71234

ETI 500 GPD UNIT W/ OREGON APPROVED DOSING SEPTIC TANK & HIGH HEAD PUMP STATION

NO PART OF THIS DOCUMENT MAY BE REPRODUCED, STORED IN ANY RETRIEVAL SYSTEM, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE WITHOUT THE PRIOR WRITTEN PERMISSION OF ECOLOGICAL TANKS, INC.


SCALE:
NTS

DATE
9/19/11

DRAWING NO.
AS500L-4

APPROVED

By Oregon DEQ on December 09, 2011

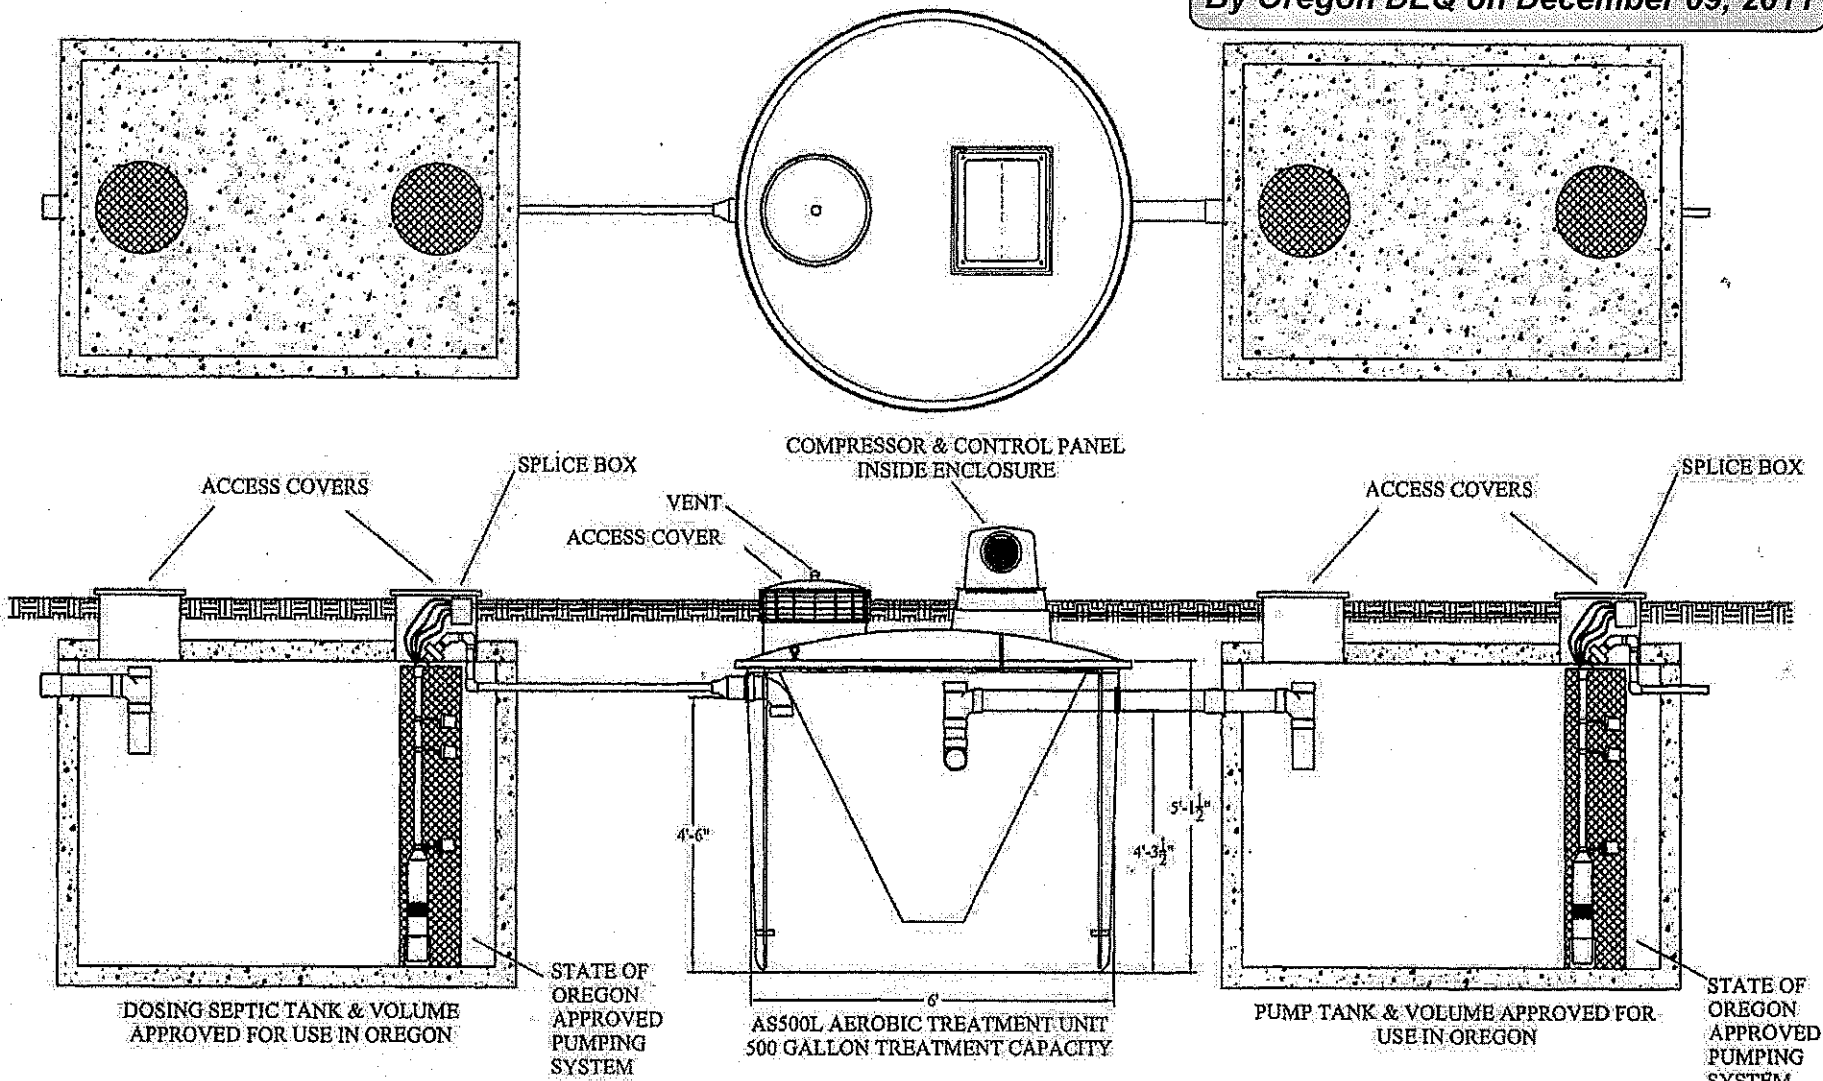


NOTES:

- 1. ALL EXTERIOR PIPE SIZES AS PER OREGON REQUIREMENTS.
- 2. THE VOLUME OF THE SEPTIC TANK WILL BE AS REQUIRED IN OAR 340-071.
- 3. AS AN OPTION, THE COMPRESSOR, CONTROL PANEL, AND ENCLOSURE CAN BE MOUNTED REMOTELY PROVIDED THEY ARE WITHIN 100' OF THE TREATMENT UNIT.

ECOLOGICAL TANKS, INC 2477 HWY 151 NORTH DOWNSVILLE, LA 71234	ETI 500 GPD UNIT W/ OREGON APPROVED DOSING SEPTIC TANK & PUMP TANK		
	<small>NO PART OF THIS DOCUMENT MAY BE REPRODUCED, STORED IN ANY RETRIEVAL SYSTEM, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE WITHOUT THE PRIOR WRITTEN PERMISSION OF ECOLOGICAL TANKS, INC.</small>	SCALE: NTS	DATE 11/14/11

APPROVED

By Oregon DEQ on December 09, 2011

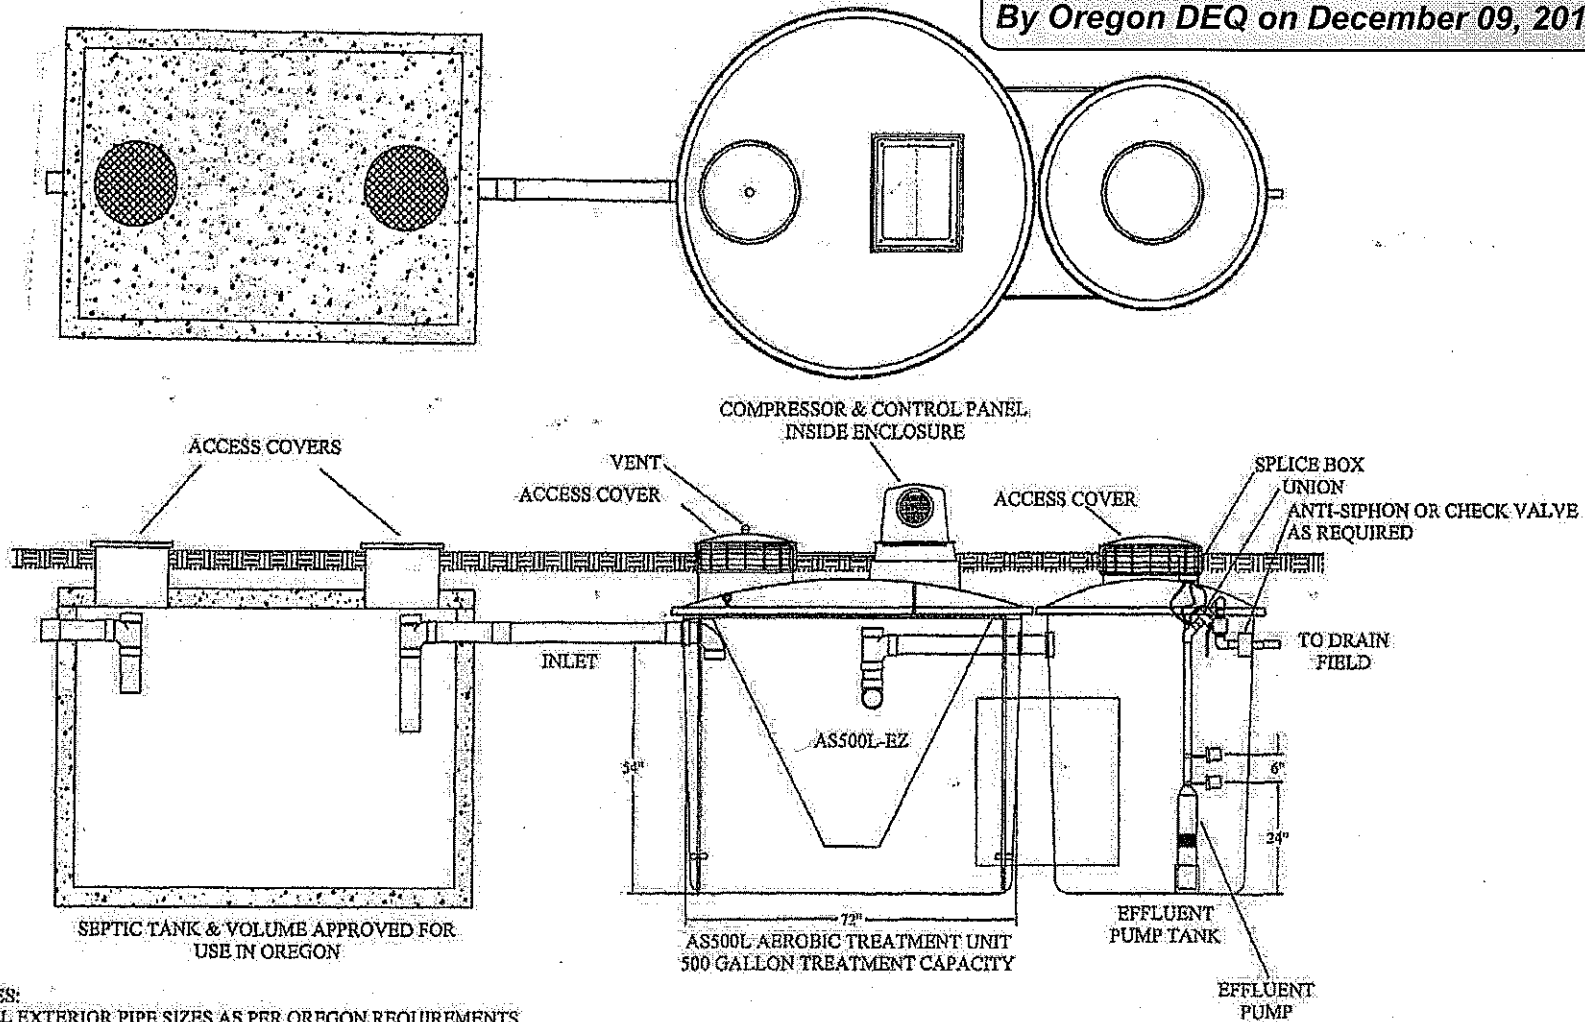

SEPTIC TANK & VOLUME APPROVED FOR USE IN OREGON

AS500L AEROBIC TREATMENT UNIT
500 GALLON TREATMENT CAPACITY

EFFLUENT PUMP TANK

EFFLUENT PUMP

NOTES:

1. ALL EXTERIOR PIPE SIZES AS PER OREGON REQUIREMENTS.
2. THE VOLUME OF THE SEPTIC TANK WILL BE AS REQUIRED IN OAR 340-071.
3. AS AN OPTION, THE COMPRESSOR, CONTROL PANEL, AND ENCLOSURE CAN BE MOUNTED REMOTELY PROVIDED THEY ARE WITHIN 100' OF THE TREATMENT UNIT.

ECOLOGICAL TANKS, INC
2477 HWY 151 NORTH
DOWNSVILLE, LA 71234

ETI 500 GPD UNIT W/ LAMINATED PUMP TANK & OREGON APPROVED SEPTIC TANK

NO PART OF THIS DOCUMENT MAY BE REPRODUCED, STORED IN ANY RETRIEVAL SYSTEM, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE WITHOUT THE PRIOR WRITTEN PERMISSION OF ECOLOGICAL TANKS, INC.

SCALE:
NTS

DATE
11/14/11

DRAWING NO.
AS500L-5