


PLAN APPROVED

Date 7/28/11 Signed DFW

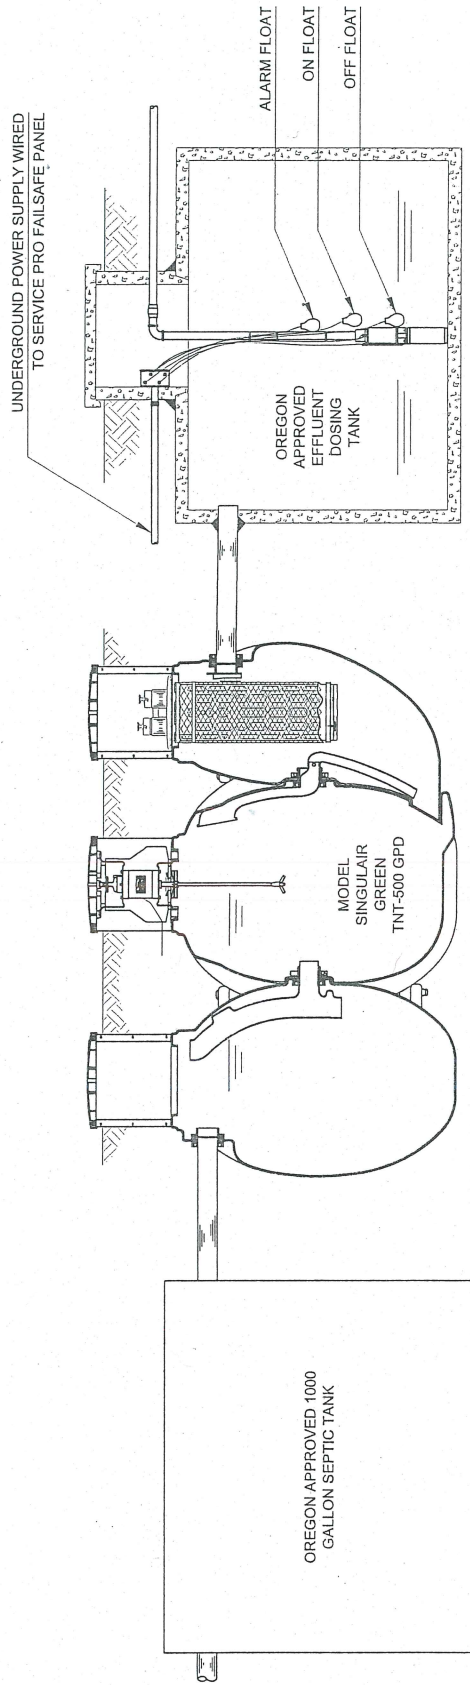

TREATMENT STANDARD #1 - PRESSURE DISTRIBUTION TO RECEIVING ENVIRONMENT

GENERAL NOTES:


1. FAILSAFE CONTROLS WILL SHUT DOWN EFFLUENT PUMP IF THERE IS A MALFUNCTION IN THE AERATOR OPERATION.
2. FAILSAFE CONTROLS WILL ALARM AND NOTIFY THE SERVICE PROVIDER IN THE EVENT OF A MALFUNCTION.
3. FAILSAFE CONTROLS WILL ALARM IF EFFLUENT LEVEL REACHES THE ALARM FLOAT.

PART NUMBER:	
U.S. AND FOREIGN PATENTS PENDING	norweco
TYPE	TREATMENT STANDARD #1 FLOW THROUGH SCHEMATICS
DATE	4-13-11
DESIGNER	NTS
PROJECT NO.	PC-S-9982

Approved
September 23, 2013



State of Oregon
Department of
Environmental
Quality

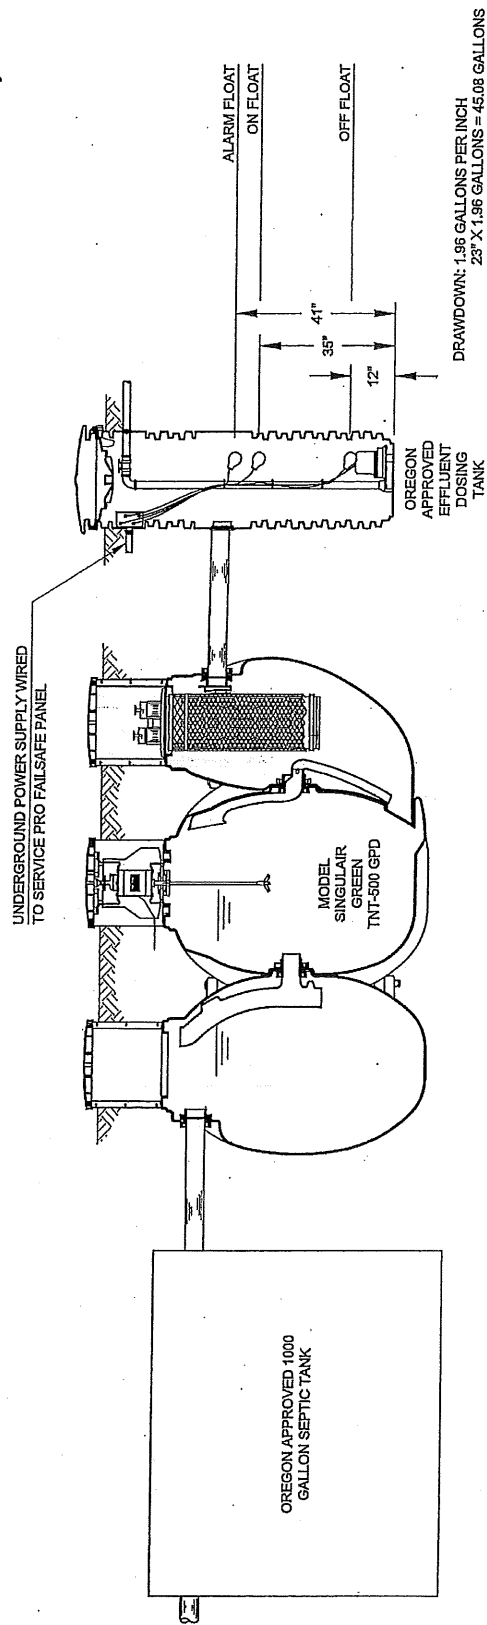

TREATMENT STANDARD #1 - PRESSURE DISTRIBUTION TO RECEIVING ENVIRONMENT

GENERAL NOTES:

1. FAILSAFE CONTROLS WILL SHUT DOWN EFFLUENT PUMP IF THERE IS A MALFUNCTION IN THE AERATOR OPERATION.
2. FAILSAFE CONTROLS WILL ALARM AND NOTIFY THE SERVICE PROVIDER IN THE EVENT OF A MALFUNCTION.
3. FAILSAFE CONTROLS WILL ALARM IF EFFLUENT LEVEL REACHES THE ALARM FLOAT.

PART NUMBER:		norweco®	
U.S. AND FOREIGN FUNDING	DATE	REVISED	BY
MAX001	07-29-2010	08-15-2011	A
TREATMENT STANDARD #1 FLOW THROUGH SCHEMATICS		VPE	JMM
PC-5-9992		NTS	